




PROPER SEPTIC SYSTEM VENTING

From Appendix 75-A Water Treatment NYS Department of Health 75-A.5 House Sewer and 75-A.6.

"THE HOUSE SEWER SHALL ALLOW FOR VENTING OF GASES FROM THE SEWAGE SYSTEM".
"TANK SYSTEMS...SHALL ALSO BE DESIGNED TO PERMIT THE VENTING OF TANK GASES"

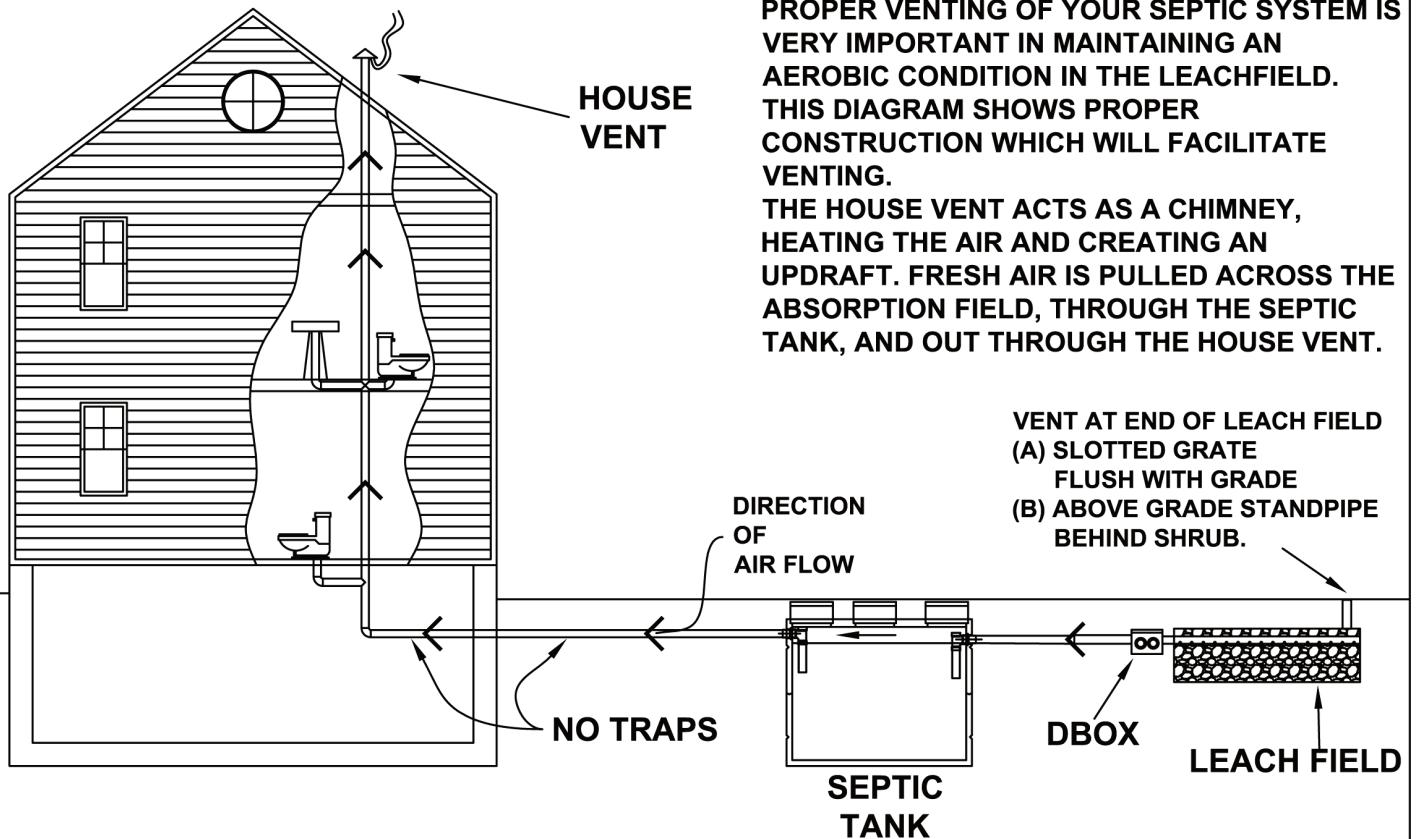

SEPTIC SYSTEM INSPECTION & MAINTENANCE

SEPTIC TANKS SHOULD BE INSPECTED ANNUALLY TO DETERMINE THAT THE INLET AND OUTLET BAFFLES/TEES ARE IN PLACE. ALL BAFFLES, INLET AND OUTLET PIPING SHOULD BE INSPECTED USING A STRONG LIGHT. REPAIRS SHOULD BE MADE IF NECESSARY. DO NOT ENTER SEPTIC TANKS. SEPTIC TANKS MAY CONTAIN TOXIC GASES CAUSED BY BIOLOGICAL ACTIVITY.

(SOURCE: N.Y.D.O.H. DESIGN HANDBOOK 1996-)